


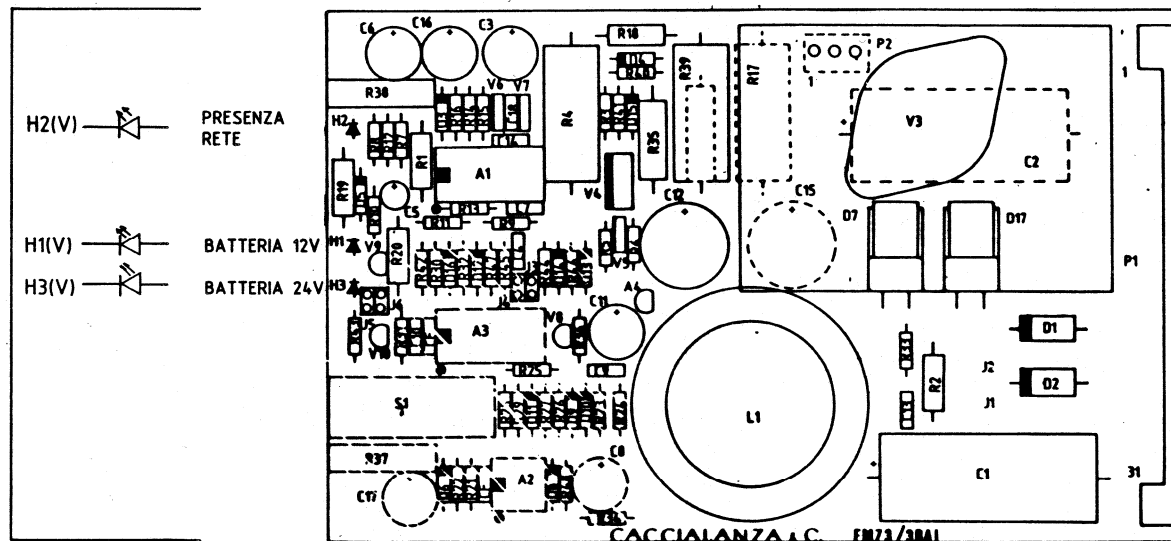

P2	
1	COLLETTORE
2	EMETTITORE
3	BASE

P1	
1	MANCANZA RETE (PULSATA)
2	—
3	—
4	OUT 12Vcc
5	OUT 12Vcc
6	OUT 12Vcc
7	(NON COLLEGATO)
8	(NON COLLEGATO)
9	BATTERIA SCARICA
10	INGRESSO ALLARME MANCANZA RETE
11	0V
12	0V
13	0V
14	MANCANZA RETE
15	IN 36V~
16	IN 36V~
17	IN 36V~
18	IN 36V~
19	~
20	~
21	SCHEDA GUASTA
22	PRESENZA RETE
23	(NON COLLEGATO)
24	(NON COLLEGATO)
25	—
26	—
27	BATTERIA 12Vcc
28	BATTERIA 12Vcc
29	BATTERIA 12Vcc
30	BATTERIA 0V cc
31	BATTERIA 0V cc

IMPORTANTE :

CACCIALANZA & C. S.p.A. si riserva il diritto di modificare senza preavviso le informazioni contenute su questa scheda con il proposito di apportare miglioramenti alla produzione

IMPORTANT :

CACCIALANZA & C. S.p.A. reserves the right to change or modify without previous notice any data or specification due to changes or modification in order to improve the products presented

0	28.06.99	EMESSO	CA	CA	
Rev.	Date	Description	Drawn	Checked	Approved
		CACCIALANZA & C. S.p.A. ANTINCENDIO SICUREZZA ANTINQUINAMENTO SEGRATE (MILANO) - ITALY	Client / Project		
			Title SCHEDA 3BAI-12 PER FMZ3 VISTA COMPONENTI		
Drawn	28.06.99	CA	Size A3	Scale 1:1	Dwg nr. 31049216
Checked	28.06.99	CA			
Approved					
Code 3193152109		Sys. 			
					Rev. 0
					Sheet 1 of 1

THIS DRAWING IS THE PROPERTY OF CACCIALANZA & C. S.p.A. AND IS NOT TO BE REPRODUCED OR USED TO FURNISH ANY INFORMATION FOR MAKING OF DRAWINGS OR APPARATUS EXCEPT WHERE PROVIDED FOR BY AGREEMENT WITH SAID COMPANY