


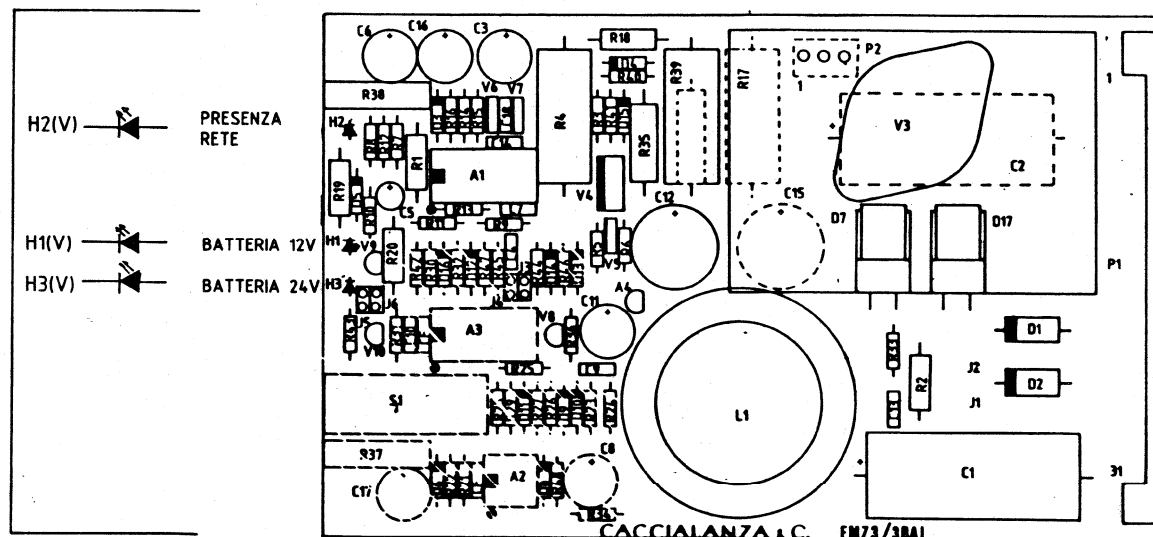

P2	
1	COLLETTORE
2	EMETTITORE
3	BASE

P1	
1	MANCANZA RETE (PULSATA)
2	OUT 24Vcc
3	OUT 24Vcc
4	—
5	—
6	—
7	(NON COLLEGATO)
8	(NON COLLEGATO)
9	BATTERIA SCARICA
10	INGRESSO ALLARME MANCANZA RETE
11	—
12	—
13	—
14	MANCANZA RETE
15	IN 36V~
16	IN 36V~
17	IN 36V~
18	IN 36V~
19	~
20	~
21	SCHEDA GUASTA
22	PRESENZA RETE
23	(NON COLLEGATO)
24	(NON COLLEGATO)
25	BATTERIA 24Vcc
26	BATTERIA 24Vcc
27	—
28	—
29	—
30	BATTERIA 0Vcc
31	BATTERIA 0Vcc

IMPORTANTE :

CACCIALANZA & C. S.p.A. si riserva il diritto di modificare senza preavviso le informazioni contenute su questa scheda con il proposito di apportare miglioramenti alla produzione

IMPORTANT :

CACCIALANZA & C. S.p.A. reserves the right to change or modify without previous notice any data or specification due to changes or modification in order to improve the products presented

0	28.06.99	EMESSO	CA	CA	
Rev.	Date	Description	Drawn	Checked	Approved
		CACCIALANZA & C. S.p.A. ANTINCENDIO SICUREZZA ANTINQUINAMENTO SEGRATE (MILANO) - ITALY	Client / Project		
		Drawn	Date	Name	Title SCHEDA 3BABI-24 PER FM73 VISTA COMPONENTI
		Checked	28.06.99	CA	
		Approved			
Code 3193152129		Sys. 	Size A3	Scale 1:1	Dwg nr. 31049218
			Rev. 0	Sheet 1 of 1	

THIS DRAWING IS THE PROPERTY OF CACCIALANZA & C. S.p.A. AND IS NOT TO BE REPRODUCED OR USED TO FURNISH ANY INFORMATION FOR MAKING OF DRAWINGS OR APPARATUS EXCEPT WHERE PROVIDED FOR BY AGREEMENT WITH SAID COMPANY