


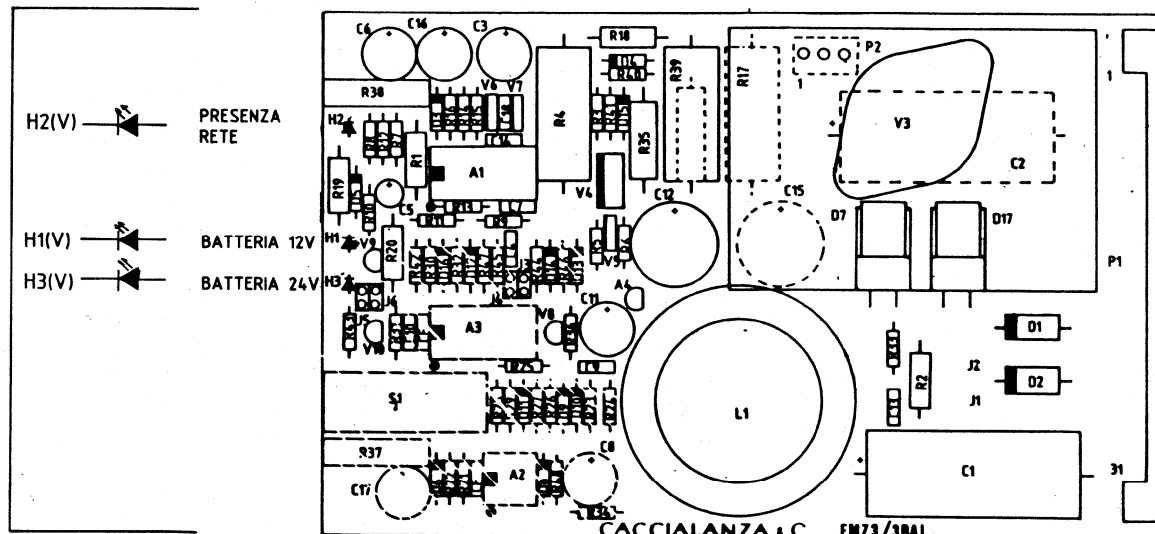

P2	
1	COLLETTORE
2	EMETTITORE
3	BASE

P1	
1	MANCANZA RETE (PULSATA)
2	OUT 24Vcc
3	OUT 24Vcc
4	—
5	—
6	—
7	(NON COLLEGATO)
8	(NON COLLEGATO)
9	BATTERIA SCARICA
10	INGRESSO ALLARME MANCANZA RETE
11	—
12	—
13	—
14	MANCANZA RETE
15	IN 36V~
16	IN 36V~
17	IN 36V~
18	IN 36V~
19	~
20	~
21	SCHEDA GUASTA
22	PRESENZA RETE
23	(NON COLLEGATO)
24	(NON COLLEGATO)
25	BATTERIA 24Vcc
26	BATTERIA 24Vcc
27	—
28	—
29	—
30	BATTERIA 0Vcc
31	BATTERIA 0Vcc

IMPORTANTE :

CACCIALANZA & C. S.p.A. si riserva il diritto di modificare senza preavviso le informazioni contenute su questa scheda con il proposito di apportare miglioramenti alla produzione

IMPORTANT :

CACCIALANZA & C. S.p.A. reserves the right to change or modify without previous notice any data or specification due to changes or modification in order to improve the products presented

0	28.06.99	EMESSO	CA	CA	
Rev.	Date	Description	Drawn	Checked	Approved
CACCIALANZA & C. S.p.A.		Client / Project			
ANTINCENDIO SICUREZZA ANTINQUINAMENTO		Title			
SEGRATE (MILANO) - ITALY		SCHEDA 3BK1 PER FMZ3			
Drawn	Date	Name	VISTA COMPONENTI		
Checked	28.06.99	CA			
Approved					
Code	3193152209	Sys.	Size	Scale	Dwg nr.
			A3	1:1	31049226
					Rev.
					0
					Sheet
					1
					of
					1

THIS DRAWING IS THE PROPERTY OF CACCIALANZA & C. S.p.A. AND IS NOT TO BE REPRODUCED OR USED TO FURNISH ANY INFORMATION FOR MAKING OF DRAWINGS OR APPARATUS EXCEPT WHERE PROVIDED FOR BY AGREEMENT WITH SAID COMPANY