

0	12.02.02	ISSUED		AC	AC
Rev.	Date	Description	Drawn	Checked	Approved
CACCIALANZA & C. s.p.A. ANTINCENDIO SICUREZZA ANTINQUINAMENTO SEGRATE (MILANO) - ITALY		Client / Project			
		Title			
		FIELD COMMAND PANEL UZK LKS6 EEXD EXECUTION			
	Date	Name			
Drawn	12.02.02	CA			
Checked	12.02.02	CA			
Approved	12.02.02	AM			
Code	Sys.	Size	Scale	Dwg nr.	Rev. Sheet
		A3		46414701	0 1
					of 3
THIS DRAWING IS THE PROPERTY OF CACCIALANZA & C. S.p.A. AND IS NOT TO BE REPRODUCED OR USED TO FURNISH ANY INFORMATION FOR MAKING OF DRAWINGS OR APPARATUS EXCEPT WHERE PROVIDED FOR BY AGREEMENT WITH SAID COMPANY					

a b c d e f g h i j k m n p q r

0

1

2

PANEL BOARD TECHNICAL DATA

RATED SERVICE VOLTAGE:.....400V	TYPE OF SEGREGATION:.....FORM 1	TEMPERATURE:.....40°C
RATED INSULATION VOLTAGE:.....1000V	INSTALLATION:.....OUTDOOR	DEGREE OF PROTECTION:see page 10-11
RATED FREQUENCY:.....50Hz	COMPLIANCE WITH STANDARD:.....CEI 17/13.1	COLOR:.....RED RAL7032
ELECTRICAL SYSTEM:.....3Ph+PE	IN/OUT CABLES:.....BOTTOM	

3

4

5

6

7

8

9

CACCIALANZA & C. S.p.A.
 ANTINCENDIO SICUREZZA ANTINQUINAMENTO
 SEGRATE (MILANO) - ITALY


TITLE
 FIELD COMMAND PANEL
 TYPE A3-A4-A6-A8/EL

CLIENT

		DATE	12.02.02	DWG N°	46414701
		SCALE			
		DRAWN	CA		
0	ISSUED	12.02.02	CHECKED	CA	PROJECT N°
REV.	MODIFY	DATE	APPROVED		SHEET N° 3 OF 4

a b c d e f g h i j k m n p q r

0
1
2
3
4
5
6
7
8
9

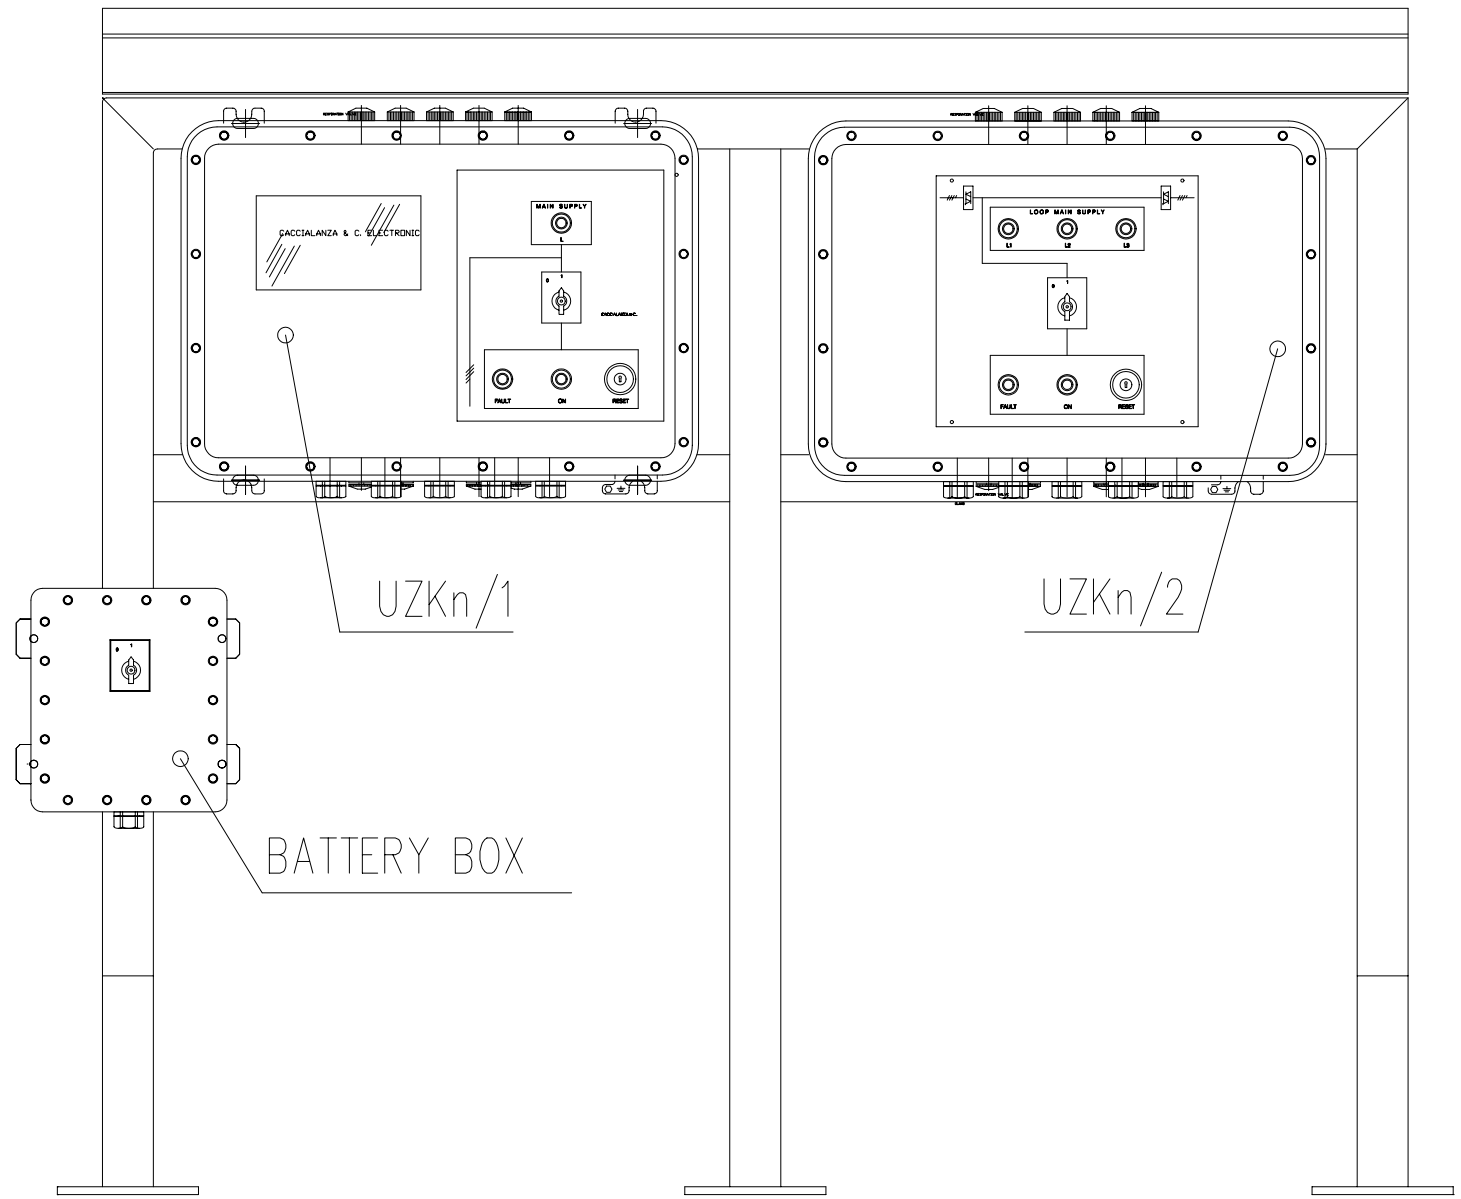

UZKn/1

UZKn/2

BATTERY BOX

TO GET THE ELECTRICAL DAIGRAM OF THIS PANEL
PLEASE CONTACT OUR COMPANY

CACCIALANZA & C. S.p.A.
ANTINCENDIO SICUREZZA ANTINQUINAMENTO
SEGRATE (MILANO) - ITALY

TITLE
FIELD COMMAND PANEL
TYPE A3-A4-A6-A8/EL

CLIENT

		DATE	12.02.02	DWG N°	46414701
		SCALE			
		DRAWN	CA		
0	ISSUED	12.02.02	CHECKED	CA	PROJECT N°
REV.	MODIFY	DATE	APPROVED		SHEET N°. 4 OF 4