


0	12.02.02	ISSUED		AC	AC					
Rev.	Date	Description	Drawn	Checked	Approved					
CACCIALANZA & C. s.p.A. ANTINCENDIO SICUREZZA ANTINQUINAMENTO SEGRATE (MILANO) - ITALY			Client / Project							
			Title							
			FIELD COMMAND PANEL UZKP LKS6 EEXD EXECUTION							
	Date	Name								
Drawn	12.02.02	CA								
Checked	12.02.02	CA								
Approved	12.02.02	AM								
Code		Sys.	Size	Scale	Dwg nr.	Rev.	Sheet			
			A3		46414801	0	1			
							of	3		
THIS DRAWING IS THE PROPERTY OF CACCIALANZA & C. S.p.A. AND IS NOT TO BE REPRODUCED OR USED TO FURNISH ANY INFORMATION FOR MAKING OF DRAWINGS OR APPARATUS EXCEPT WHERE PROVIDED FOR BY AGREEMENT WITH SAID COMPANY										

a b c d e f g h i j k m n p q r

0

1

2

PANEL BOARD TECHNICAL DATA

RATED SERVICE VOLTAGE:.....400V	TYPE OF SEGREGATION:.....FORM 1	TEMPERATURE:.....40°C
RATED INSULATION VOLTAGE:.....1000V	INSTALLATION:.....OUTDOOR	DEGREE OF PROTECTION:see page 10-11
RATED FREQUENCY:.....50Hz	COMPLIANCE WITH STANDARD:.....CEI 17/13.1	COLOR:.....RED RAL7032
ELECTRICAL SYSTEM:.....3Ph+PE	IN/OUT CABLES:.....BOTTOM	

3

4

5

6

7

8

9

CACCIALANZA & C. S.p.A.
 ANTINCENDIO SICUREZZA ANTINQUINAMENTO
 SEGRATE (MILANO) - ITALY

TITLE
 FIELD COMMAND PANEL
 TYPE A3-A4-A6-A8/EL

CLIENT

		DATE	12.02.02	DWG N°	46414801
		SCALE			
		DRAWN	CA		
0	ISSUED	12.02.02	CHECKED	CA	PROJECT N°
REV.	MODIFY	DATE	APPROVED		SHEET N° 3 OF 4

a b c d e f g h i j k m n p q r

0

1

2

3

4

5


6

7

8

9

UZKP

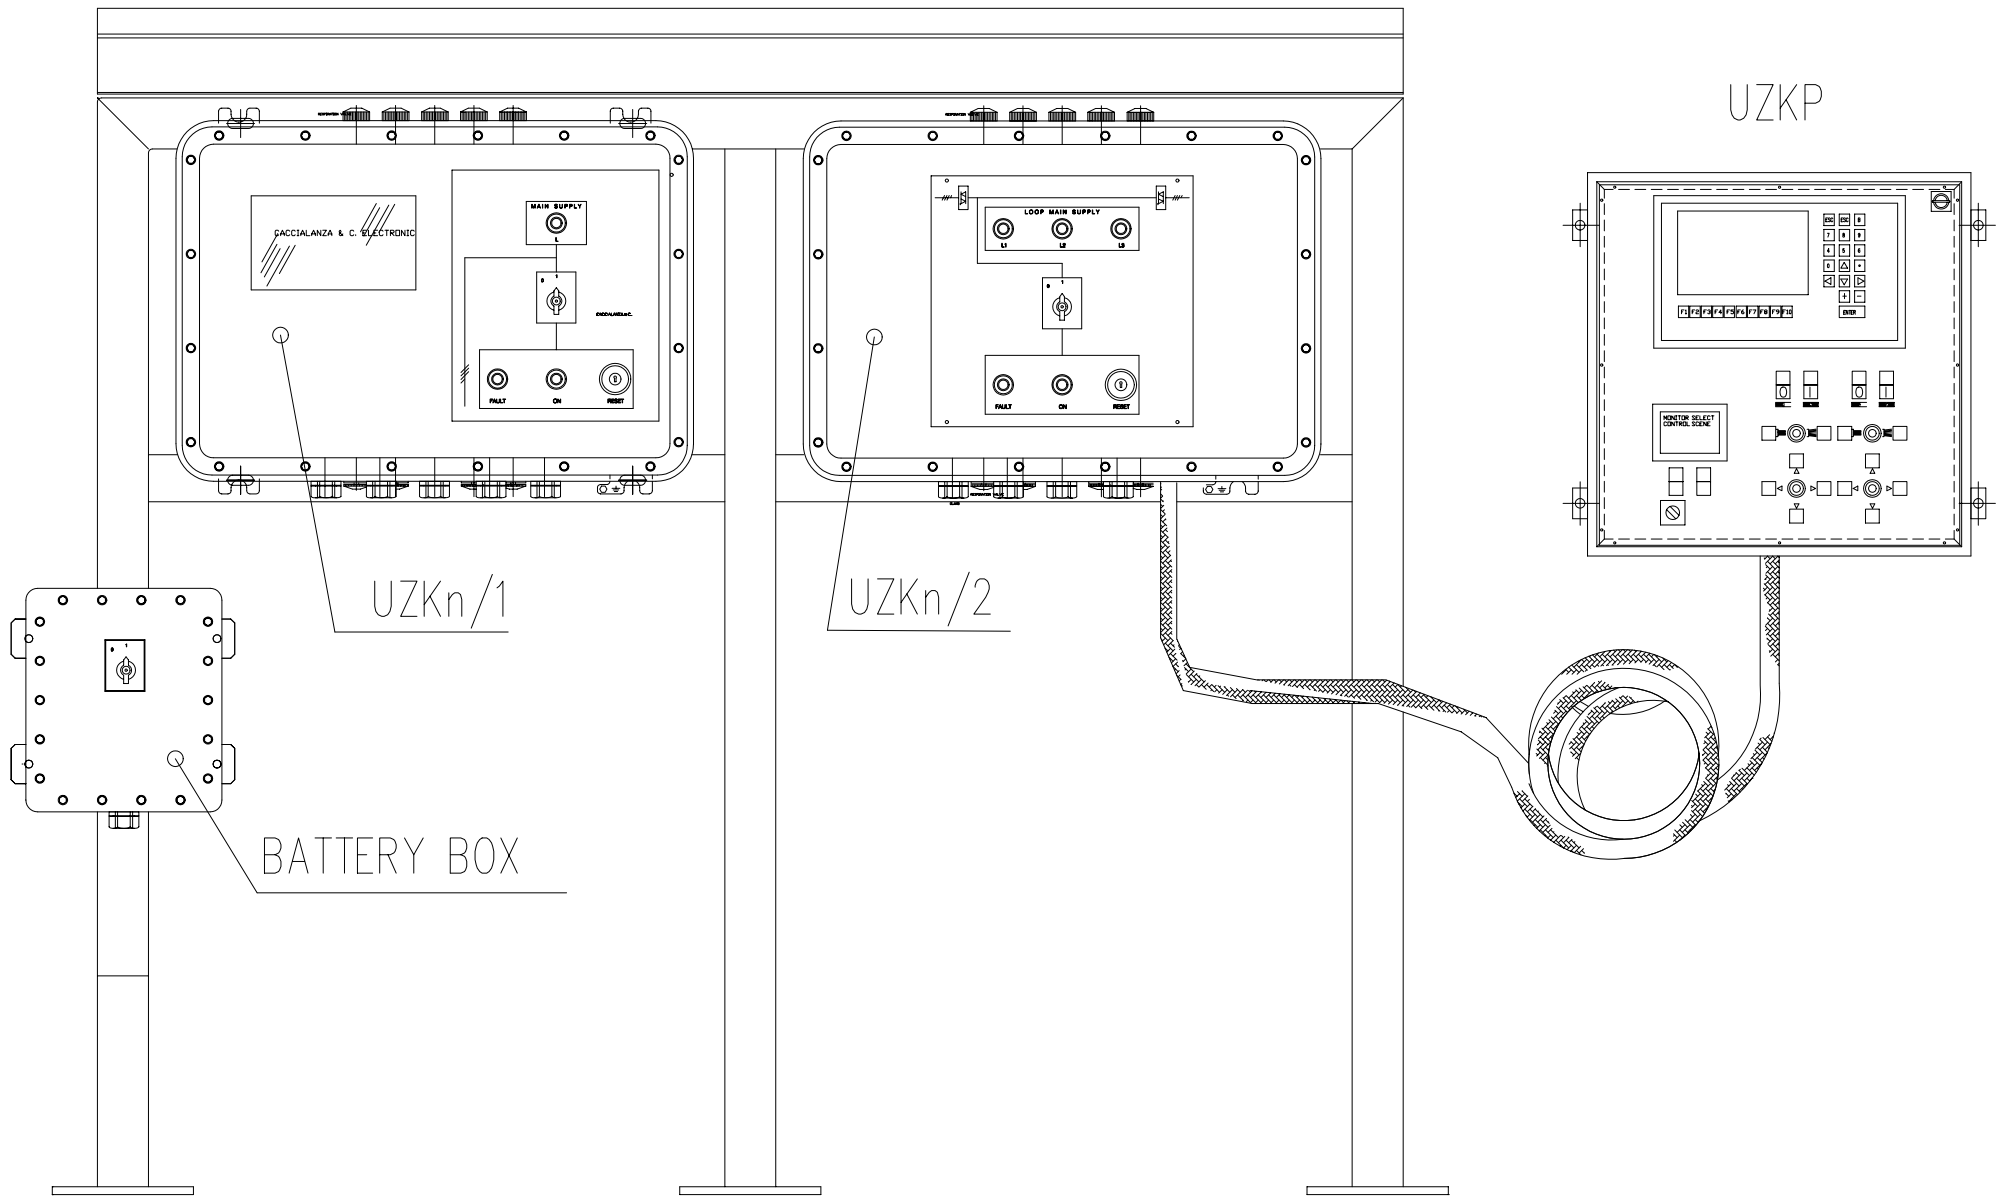

UZKn/1

UZKn/2

BATTERY BOX

TO GET THE ELECTRICAL DAIGRAM OF THIS PANEL
PLEASE CONTACT OUR COMPANY

CACCIALANZA & C. S.p.A.
ANTINCENDIO SICUREZZA ANTINQUINAMENTO
SEGRATE (MILANO) - ITALY

TITLE
FIELD COMMAND PANEL
TYPE A3-A4-A6-A8/EL

CLIENT

		DATE	12.02.02
		SCALE	
		DRAWN	CA
0	ISSUED	12.02.02	CHECKED CA
REV.	MODIFY	DATE	APPROVED

DWG N° 46414801
PROJECT N°
SHEET N. 4 OF 4